

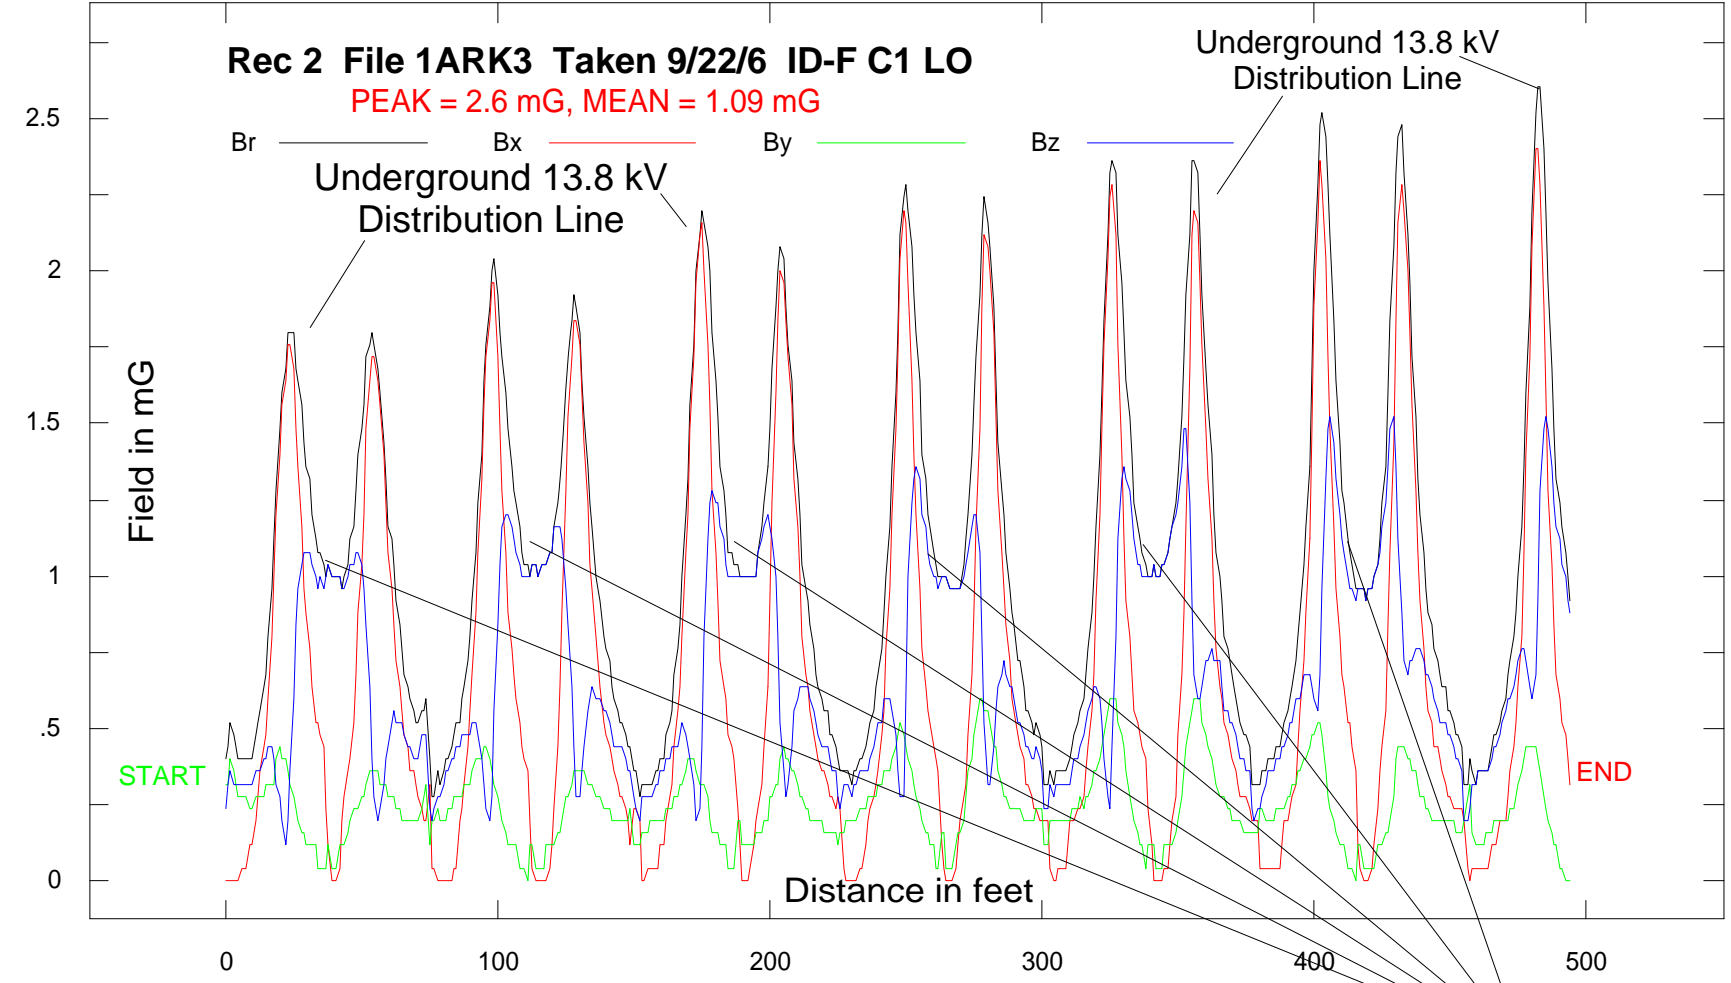


South - Manhole & Transformer

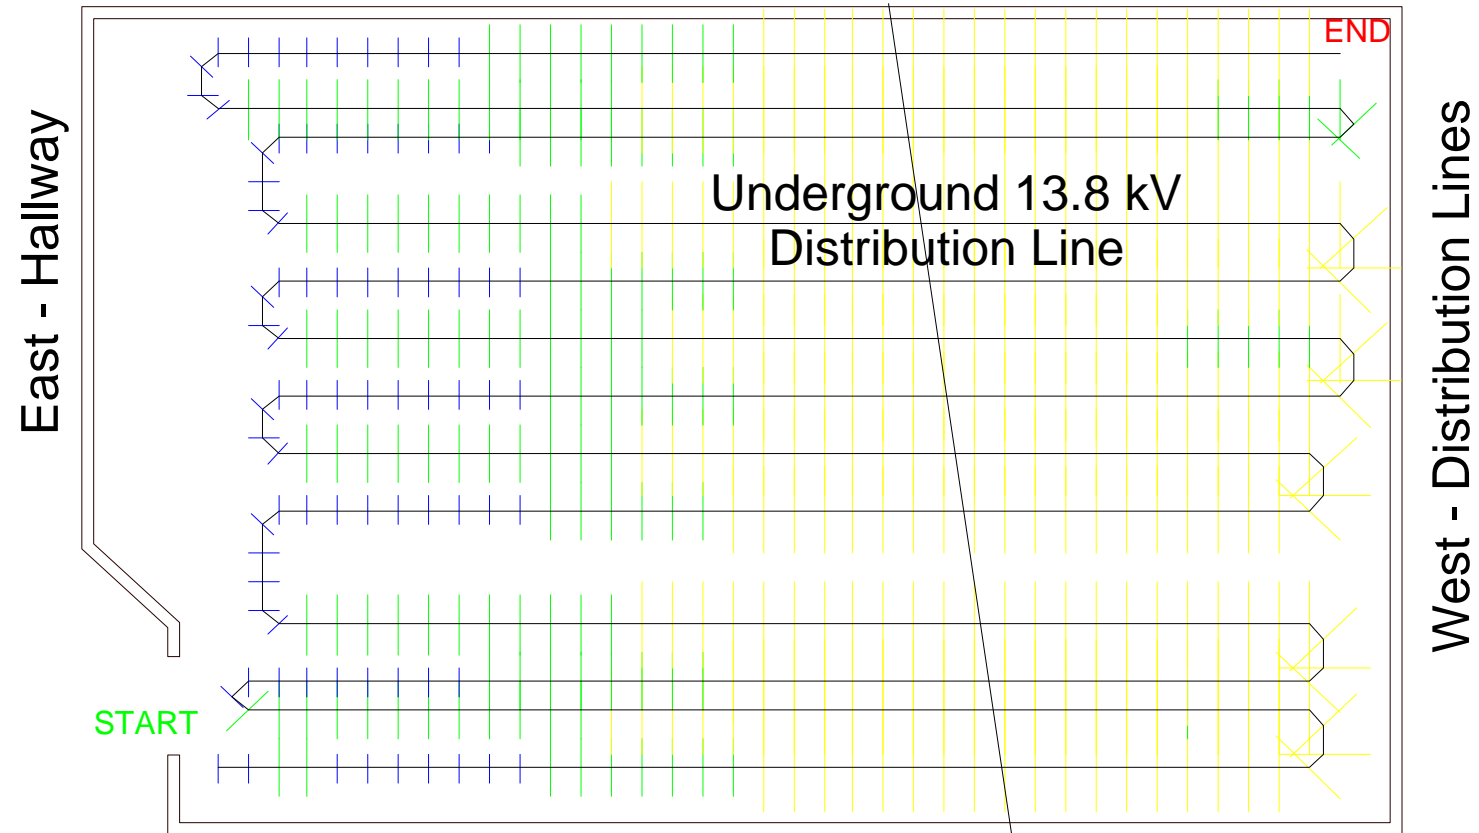


North - Classroom

Rec 2 File 1ARK3 Taken 9/22/6 ID-F C1 LO
 PEAK = 2.6 mG, MEAN = 1.09 mG




Survey Wheel Path Direction - Bx

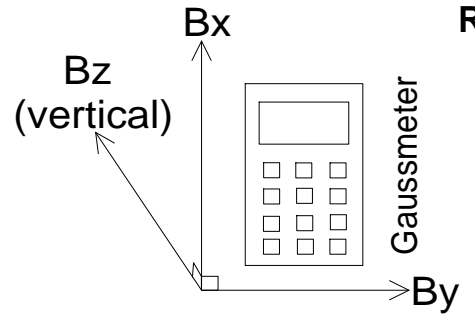

AC ELF Magnetic Flux Density Thresholds		
JOEL 2100	JOEL 7000F	JOEL 7000F 1K
Bx 0.25 mG rms	Bx 0.35 mG rms	Bx 0.11 mG rms
By 0.25 mG rms	By 0.35 mG rms	By 0.11 mG rms
Bz 0.11 mG rms	Bz 0.35 mG rms	Bz 0.11 mG rms
Br 0.37 mG rms	Br 0.61 mG rms	Br 0.19 mG rms

Rec 2 File 1ARK3 Taken 9/22/6 ID-F C1 LO

PEAK = 2.6 mG, MEAN = 1.09 mG

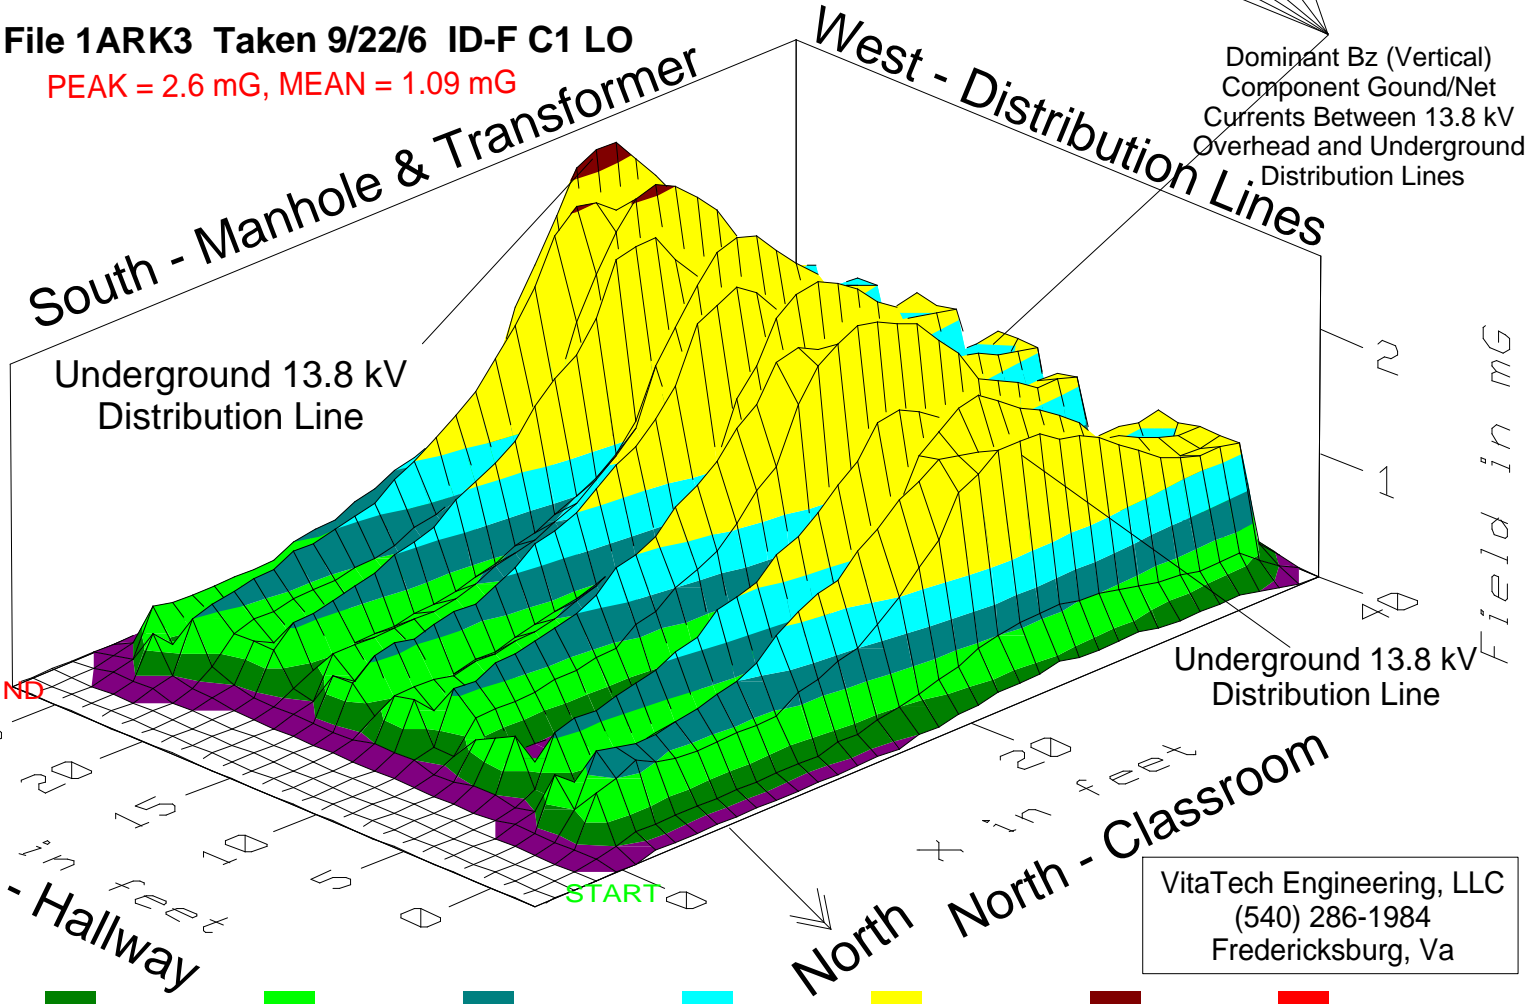

AC ELF Magnetic Field Human Exposure Standards


NYS Public Service Commission
 200 mG @ 1-meter on Edge -ROW or 50 ft. from 69 kV poles

IRPA/INIRC
 833 mG over 24 hours
 General Public Exposure

ACGIH
 1000 mG general public & workers with cardia pacemakers

Swiss Bunderstat
 NCRP Draft Report
 10 mG from overhead/underground transmission/distribution lines, substations, etc.

Figure #2A, Contour East-West (Lights Off) Magnetic Flux Density Levels @ Floor



VitaTech Engineering, LLC
 (540) 286-1984
 Fredericksburg, Va